

Lytespan® Track Lighting System **9033**

Radius® In-Line PowerTrip™ Kit

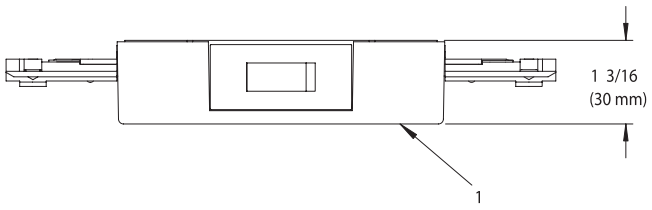

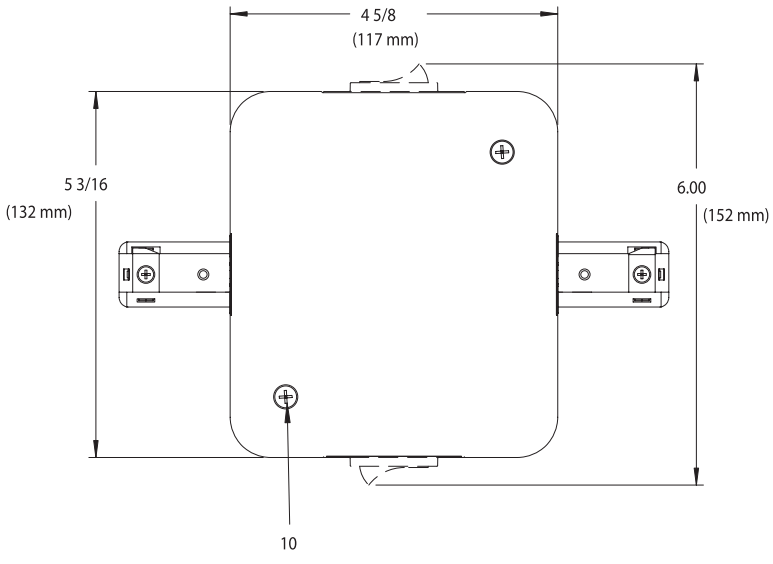

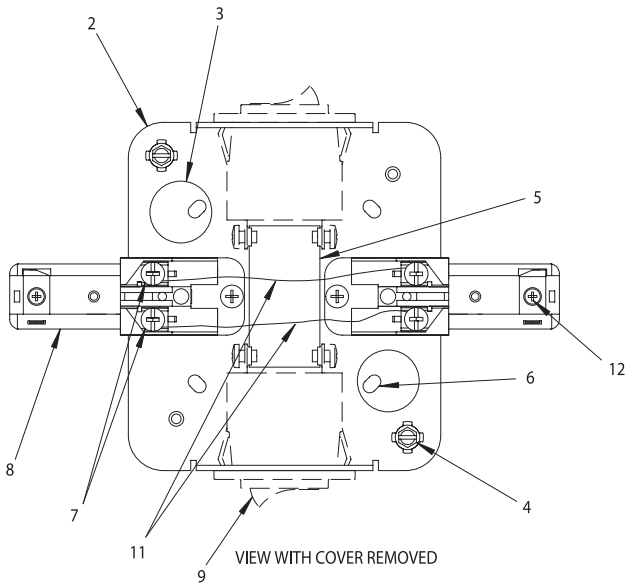

Ordering Information

Catalog No.	Finish	Mounting	Compatible Plug-In Breakers
9033WH	Matte White	Mounts directly to surface or to a 4" octagonal outlet box. Suitable for mounting to grid ceiling runners. Connects to Radius track units. NOT FOR USE WITH STEM MOUNTED RADIUS TRACK.	Compatible with PLD powerbreakers. Refer to PLD120 spec sheet. Ordered Separately
9033BK	Matte Black		

Features

1. **Wire Cover:** Plastic Polycarbonate.
2. **Mounting Plate:** .075 thick galvanized steel.
3. **Round Knock Out:** (2) .88 dia. knockouts for electrical feed. (1) or (2) circuits can be fed into connector. Offset to accomodate grid ceiling runners.
4. **Ground Terminals:** (2) ground terminals.
5. **Rectangular Knock Out:** Allows feeding from j-box with proper UL area for splice inspection without removing connector from j-box.
6. **Mounting Holes:** (4) holes on 3.5 in. centers secure connector to j-box or mounting surface.
7. **Track Connector Screw Terminals:** Each terminal accepts (2) 12 or 14 ga. copper feed wires.
8. **Basic Track Connector:** (2) assemblies keyed to maintain proper polarity with track. Installs into track providing electrical and mechanical connection.
9. **Circuit Breaker:** (Sold Separately). One or two can be installed. Limits the amount of electrical load that can be placed on the circuit. Can be used as standard On/Off switch.
10. **Cover Mounting Screws:** Pin Torx head steel screws secure plastic cover to plate. Color matches fixture color.
11. **Electrical Wires:** Two 12 ga. jumper wires are installed by factory. The wires can be removed for alternate wiring scheme.
12. **Tamperproof Locking Screw:** (2) Mechanically secures connector into track. Color matches fixture color.

Electrical

Capacity is 120 volts, 60Hz. All Lytespan Track luminaires are polarized and continuously grounded throughout. Electrical conductors are concealed in an insulating liner. Intended for wiring to branch circuit building wire with ground. All wiring must be in accordance with National and Local Codes.

Labels

U.L. listed.

Note: to assure full complaince with local energy codes and regulations check with your local code official.

Job Information	**Type:**
Job Name:	
Cat. No.:	
Lamp(s):	
Notes:	

Lightolier a Genlyte company www.lightolier.com
631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
We reserve the right to change details of design, materials and finish.
© 2008 Genlyte Group LLC • E0108

LIGHTOLIER®